


PIT DETAILS SECTION A-A

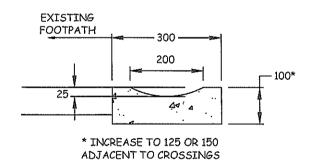

FOOTPATH DRAIN SECTION

NOTES:

- 1. 3 mm CLEARANCES TO BE LEFT AROUND GRATE.
- 2. ALL CONCRETE TO BE N32 STRENGTH GRADE.
- 3. GRATES PLACED ADJACENT TO BLUESTONE SHALL BE PAINTED WITH BLACK RUST PROOFING COMPOUND. ALL OTHER GRATES SHALL BE GALVANISED.

WHERE APPROVED

DIRECTOR INFRASTRUCTURE FOOTPATH DRAIN DRAWN: SHEET: SCALE: N.T.S. W.Du March 2003 AND PIT D 08 DWG NAME: 21500 REV:B JUN15 STDWG D08